

## THERMA V™ R32 Monobloc S at a Glance



## THERMA V™ R32 R32 Monobloc S

### THERMA V™ R32 Monobloc S

#### Enhanced installation flexibility







#### High efficiency & wide operational range




#### Innovative design & technology



Product	Capacity (kW)	Unit	Appearance
R32 Monobloc S	5	HMO51MR U44	
	7	HMO71MR U44	
	9	HMO91MR U44	
	12	HM121MR U34	HM123MR U34
	14	HM141MR U34	HM143MR U34
	16	HM161MR U34	HM163MR U34

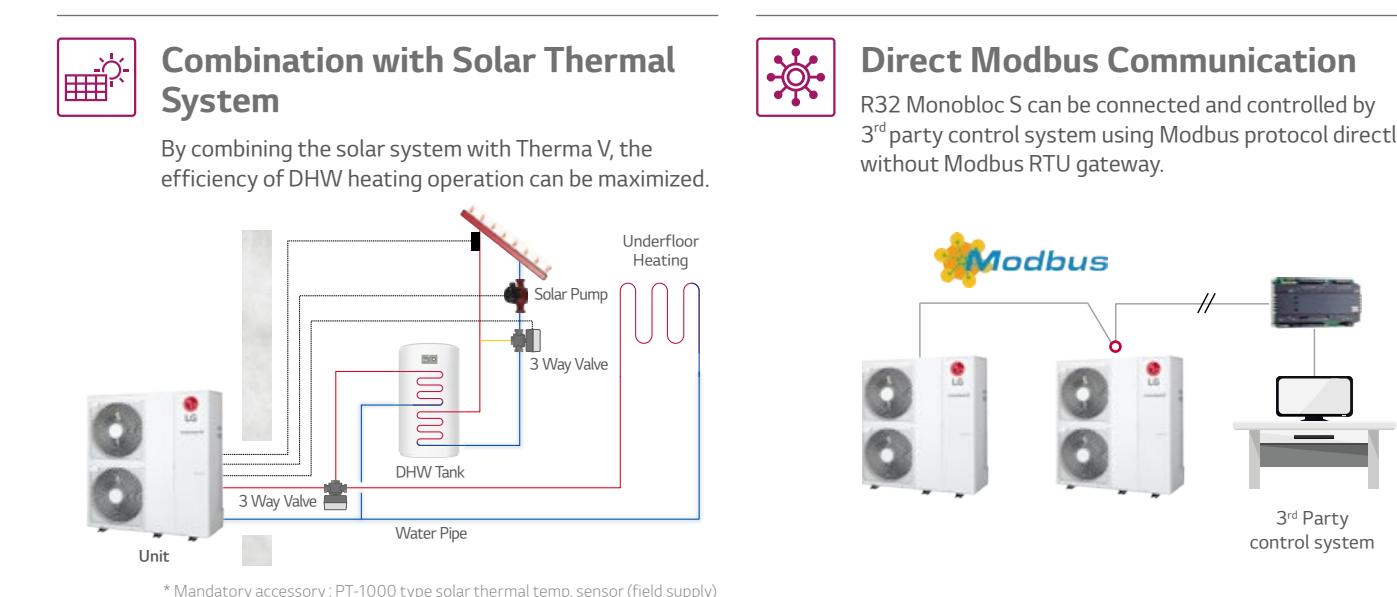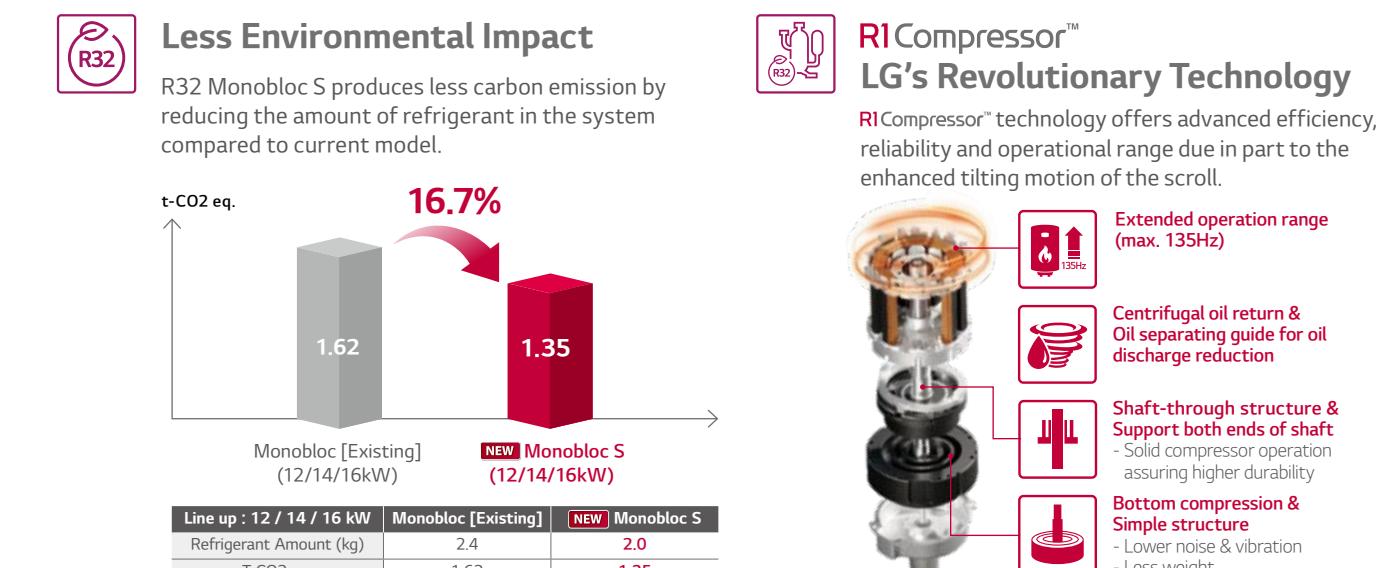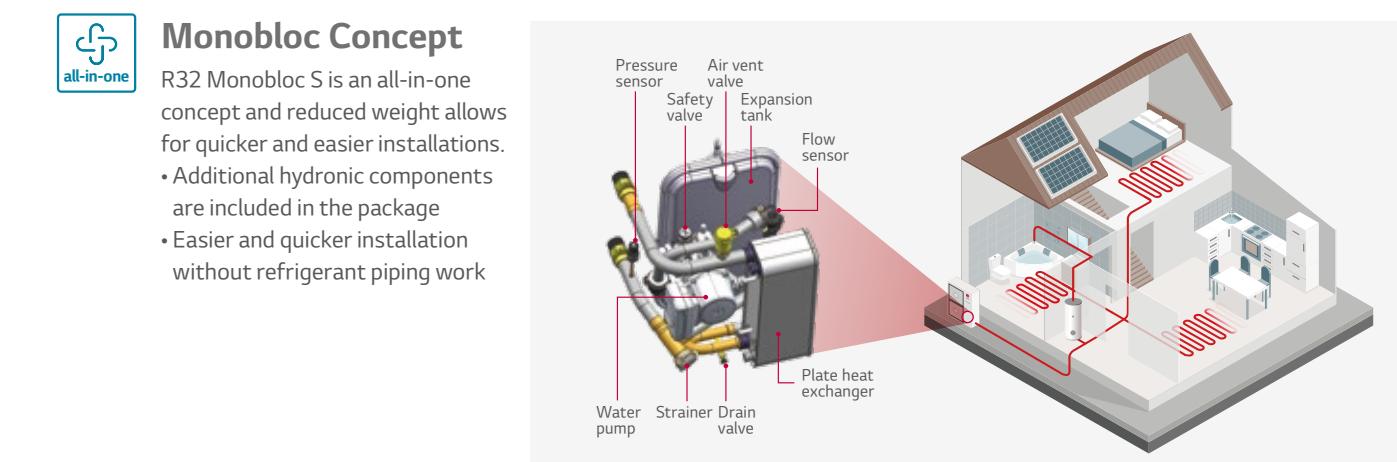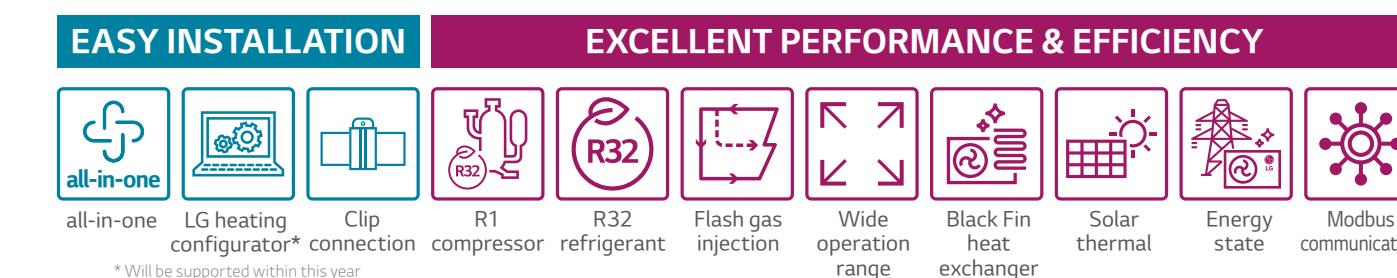


## Key Components

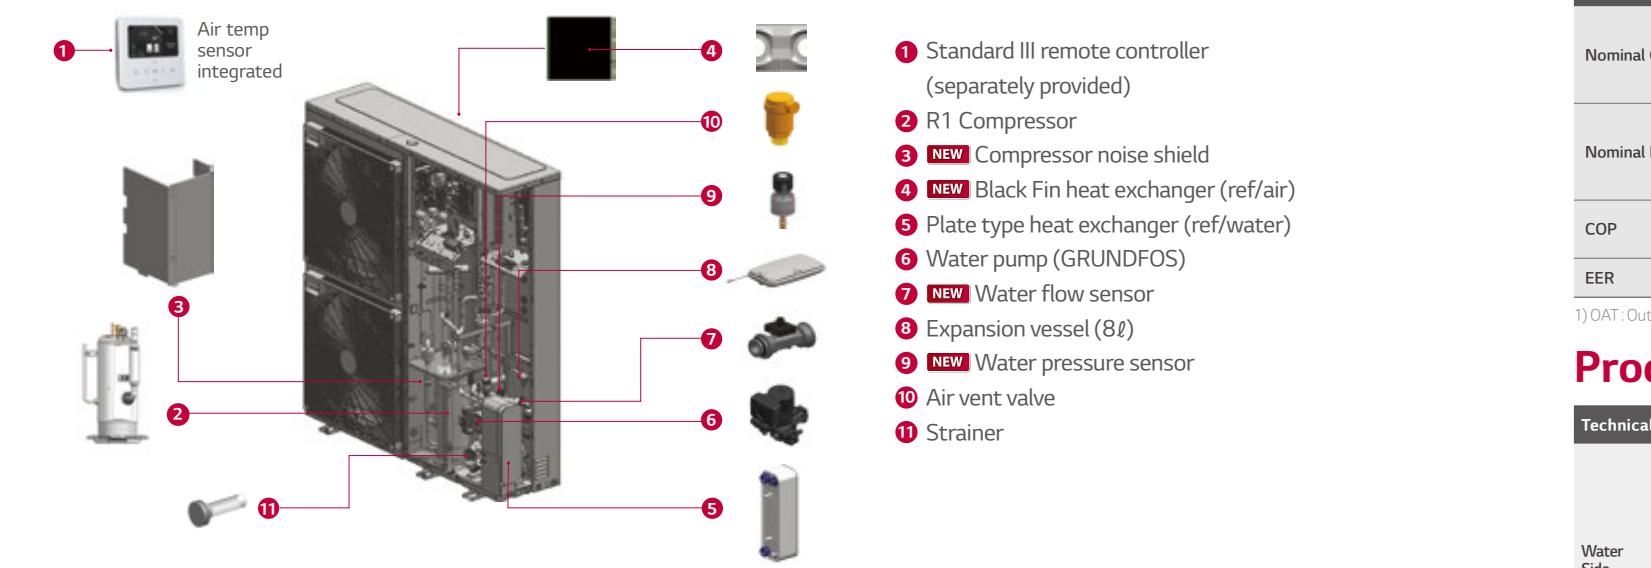


## Water Circuit Monitoring

It is possible to monitor via remote controller not only temperature of water circuit but also flow rate and pressure. These information provides installers with more reliable information for easier installation and maintenance (periodic strainer cleaning).

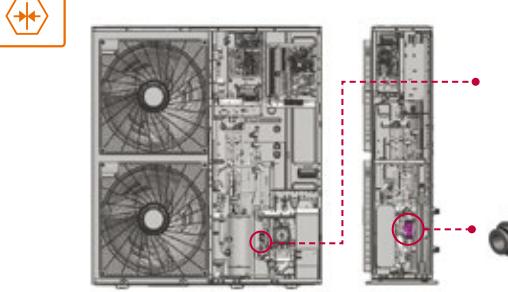

## Advanced Pump Control Options

Various pump operation options contribute to energy savings by providing optimum water pump control and reliable product operation.

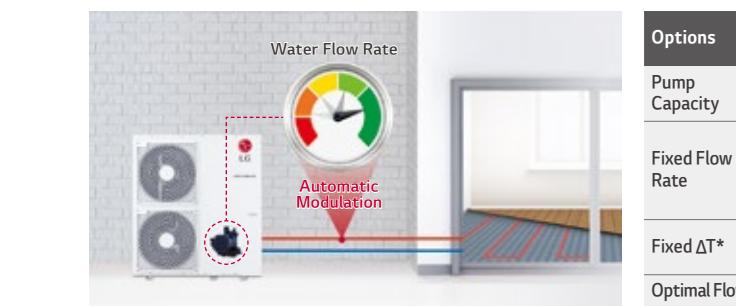

## Accessory Backup Heater

Technical Specification		Unit	HA031M E1	HA061M E1	HA063M E1
Type	-				
Number of Heating Coil	EA	1	2	3	
Capacity Combination	kW	3.0	3.0 + 3.0	2.0 + 2.0 + 2.0	
Heating Steps	Step	1	2	1	
Power Supply	V, Ø, Hz	220 - 240, 1, 50	380 - 415, 3, 50		
Current (Rated)	A	12.5	25.0	8.7	
Circuit Breaker (ELCB)	A	25	40	25	
Dimensions (W x H x D)	mm	210 x 607 x 217			
Power Cable (Included Earth, H07RN-F)	mm <sup>2</sup> x cores	1.5 x 3C	4.0 x 3C	2.5 x 4C	
Wiring Connections		Communication Cable (H07RN-F)	mm <sup>2</sup> x cores	0.75 x 4C	0.75 x 2C

## Nominal Capacity and Nominal Input

Description	OAT <sup>1)</sup> (DB)	LWT <sup>2)</sup> (DB)	Unit	HM051MR U44		HM071MR U44		HM091MR U44		HM121MR U34		HM141MR U34		HM161MR U34	
				Heating	Cooling	Heating	Cooling	Heating	Cooling	Heating	Cooling	Heating	Cooling	Heating	Cooling
Nominal Capacity	7°C 7°C 2°C	35°C 55°C 35°C	kW	5.50 5.50 4.40	7.00 5.50 5.60	9.00 5.50 11.00	12.00 12.00 12.00	14.00 14.00 14.00	16.00 16.00 13.80	12.00 12.00 12.00	11.50 11.50 12.00	12.00 12.00 12.00	12.00 12.00 12.00	12.00 12.00 12.00	12.00 12.00 12.00
Nominal Power Input	35°C 35°C 35°C	18°C 18°C 18°C	kW	5.50 1.17 2.04	7.00 1.49 2.04	9.00 1.96 3.79	12.00 2.45 4.04	14.00 2.92 4.24	16.00 3.40 4.29	12.00 12.00 12.00	11.50 11.50 12.00	12.00 12.00 12.00	12.00 12.00 12.00	12.00 12.00 12.00	12.00 12.00 12.00
COP	7°C 7°C 35°C	55°C 55°C 18°C	W/W	2.70 3.60 4.70	2.70 3.50 4.50	2.90 3.65 4.20	2.85 3.63 4.75	2.80 3.60 4.30	2.80 3.60 4.00	2.70 2.70 2.70	2.70 2.70 2.70	2.70 2.70 2.70	2.70 2.70 2.70	2.70 2.70 2.70	2.70 2.70 2.70
EER	7°C 35°C	7°C 18°C	W/W	3.30	3.20	3.10	3.30	3.30	3.10	3.30	3.30	3.10	3.30	3.30	3.10

1) OAT: Outdoor Air Temperature

2) LWT: Leaving Water Temperature

## Product Specification

Technical Specification		Unit	HM051MR U44	HM071MR U44	HM091MR U44	HM121MR U34 (10)	HM141MR U34 (10)	HM161MR U34 (10)	HM123MR U34 (30)	HM143MR U34 (30)	HM163MR U34 (30)
Operation Range (Leaving Water Temp.)	Heating Cooling	Min. - Max.	°C DB			15 - 65	5 - 27 (16 - 27) <sup>1)</sup>				
Water Pump Model	-			Grundfos UPM3K 20-75 CHB			15 - 80 <sup>2)</sup>	Grundfos UPML 20-105 CHBL			
Flow Sensor Measuring Range	l/min			5 - 80							
Water Pressure Sensor Measuring Range	bar (G)			0 - 20							
Expansion Vessel Volume	l			8							
Piping Connections	Water Circuit Inlet Outlet	inch		Male PT 1"	according to ISO 7-1 (tapered pipe threads)						
Strainer	Max. Particle Size / Material	mm / -		0.6 / Stainless Steel							
Safety Valve Pressure Limit	Upper Limit	bar		3.0							
Rated Water Flow Rate at LWT 35°C	l/min		15.8	20.1	25.9	34.5	40.3	46.0			
Operation Range (Outdoor Temp.)	Heating Cooling	Min. - Max.	°C DB			25 - 35	5 - 48				

1) When fan coil unit not used.

2) DHW 58-80°C Operating is available only when the booster heater is operating.

Note

1. Due to our policy of innovation some specifications may be changed without notification.

2. Wiring cable size must comply with the applicable local and national codes. Especially the power cable and circuit breaker should be selected in accordance with that.

3. Sound power level is measured on the rated condition in accordance with ISO 9614 standard.

Sound pressure level is converted from sound power level based on tonality penalty of 0dB and

## Seasonal Energy Efficiency

Description	Unit	HM051MR U44	HM071MR U44	HM091MR U44	SCOP		Seasonal Space Heating Efficiency (nS)		Seasonal Space Heating Efficiency Class (A+++ to D Scale)	
					Average Climate	Water Outlet 35°C	%	175	176	179
Fixed Flow Rate (According to EN14825)	SCOP	-	A+++	A+++	A+++	A+++	A+++	3.20	3.20	3.20
Fixed ΔT*	SCOP	-	A++	A++	A++	A++	A++	125	125	125
Optimal Flow Rate (default)	ΔT	is changed as per Target Temp.	Yes							

\*ΔT = temperature difference between inlet and outlet water temperature.

Description	Unit	HM121MR U34	HM141MR U34	HM161MR U34	SCOP		Seasonal Space Heating Efficiency (nS)		Seasonal Space Heating Efficiency Class (A+++ to D Scale)	
					Average Climate	Water Outlet 55°C	%	184	182	178
Backup Heater (According to EN14825)	SCOP	-	3.47	3.46	3.45					
Power Supply	V, Ø, Hz		1.36	135	135					
Current (Rated)	A	12.5	25.0	8.7						
Circuit Breaker (ELCB)	A	25	40	25						
Dimensions (W x H x D)	mm	210 x 607 x 217								
Power Cable (Included Earth, H07RN-F)	mm <sup>2</sup> x cores	1.5 x 3C	4.0 x 3C	2.5 x 4C						
Wiring Connections		Communication Cable (H07RN-F)	mm <sup>2</sup> x cores	0.75 x 4C						

\* EHPA & MCS label under development.

\* A+++ to D scale.